



City of NORTH CANTON, OHIO

145 NORTH MAIN STREET
NORTH CANTON OHIO 44720-2587

PH: (330) 499-5557

FAX: (330) 966-3630

EMAIL: permits@northcantonohio.gov

APPLICATION FOR RESIDENTIAL ELECTRIC PERMIT

DATE: _____ PERMIT # _____

LOCATION ADDRESS: _____ UNIT/FLOOR # _____
PROJECT/RESIDENTIAL NAME: _____ PHONE: _____
PROJECT NAME: _____ JOB VALUATION: _____
SQ. FT. (Round UP to nearest 10 sq. ft.) _____

TYPE OF IMPROVEMENT:
____ NEW BLDG _____ SERVICE/CHANGE _____ ADDITIONAL METERS
____ ALTER/REMODEL _____ ADDITION _____ GENERATOR
____ SIGN _____ TEMP SERVICE _____ OUTLETS, SWITCHES, LIGHTS
____ OTHER _____ FIRE ALARM DEVICES (# OF PANELS _____ # OF DEVICES _____)
____ PHASE _____ AMPERAGE _____ CONDUCTOR SIZE

IF OTHER, DESCRIBE WORK: _____

CONTRACTOR: _____ **EMAIL:** _____
ADDRESS: _____ **PHONE:** _____
CITY: _____ **STATE:** _____ **ZIP** _____

PROPERTY OWNER: _____
ADDRESS: _____ **EMAIL:** _____
CITY: _____ **STATE:** _____ **ZIP** _____
PHONE: _____

FEES OWED: (FEES COMPUTED BY CITY OFFICIALS)

	APPLICATION FEE/ONE TIME INSPECTION FEE-	\$75.00	\$ _____
		+ \$0.08 PER SQ. FT. x _____ sq. ft.	\$ _____
CHECK _____ (PAYABLE TO: CITY OF NORTH CANTON)	PLAN REVIEW FEE		\$ _____
CASH _____ (EXACT CASH <u>ONLY</u>)	SUBTOTAL		\$ _____
CREDIT CARD _____	1% BBS (multiply subtotal by .03)		\$ _____
	TOTAL		\$ _____

NOTE THERE IS A TRANSACTION FEE FOR ALL CREDIT CARDS

If you have any questions regarding fee totals please contact the office.

SIGNATURE: _____
Applicant, Agent, Owner

The applicant, agent, owner of this property and the undersigned is/does (1) agree to conform to applicable ordinances of the City of North Canton and the State of Ohio, (2) responsible to verify all property lines, (3) responsible for making arrangements for all inspections.

CALL BEFORE YOU DIG – OUPS – 1-800-362-2764

APPROVED: _____ DENIED: _____

DIRECTOR OF PERMITS AND INSPECTIONS: _____

Ohio Residential Plan Submittal Form *(Overhead Electrical Service)*


Address of Project	City	Project Description		
Contractor/DBA	Address	State License No	Phone No	Cell Phone No
Owner	Address	Phone No		Cell Phone No

Electrical Design

Panel Location in dwelling (Basement, Garage, etc.)	Size of Service in Amperes: (Check one below)				NEC 310-15 Conductor Sizes 120/240 VOLT 3-Wire, Single-Phase, Dwelling Services/Feeders
	Copper	Aluminum	Service Rating		
<input type="checkbox"/>	4 AWG	2 AWG	100 Amps		
<input type="checkbox"/>	1 AWG	2/0 AWG	150 Amps		
	<input type="checkbox"/>	2/0 AWG	200 Amps		

Electrical Service Requirements

This information is not intended as a design specification or as an instruction for untrained persons.
NEC 110.3 All electrical equipment shall be installed and used in accordance with the listing requirements and manufacturer's instructions.
NEC 250.50 All grounding electrodes that are present at each building or structure served shall be bonded together to form the grounding electrode system. Conductor size per NEC 250.66. NEC 250.52 Permitted Electrodes include:
1. Metal underground water pipe in direct contact with earth for 10 feet or more 2. Metal frame of the building 3. Concrete-encased electrode 4. Rod, pipe & plate electrodes
NEC 230.66 Service equipment shall be marked to identify it as being suitable for use as service equipment.
NEC 230.70(A)(1) The service disconnecting means shall be installed at a readily accessible location either outside of a building or structure or inside nearest the point of entrance of the service conductors
NEC 230.70(A)(3) Service disconnecting means shall not be installed in bathrooms.
NEC 230.71(A) & 230.72(A) The service disconnect shall consist of not more than six switches or six sets of circuit breakers. These switches or circuit breakers shall be grouped at one location.
NEC 230.79(C) The service disconnect shall have a rating of not less than 100 amperes.
NEC 230.90 & 230.91 Each ungrounded service conductor shall have overload protection. The service overcurrent device shall be an integral part of the service disconnecting means or shall be located immediately adjacent thereto.

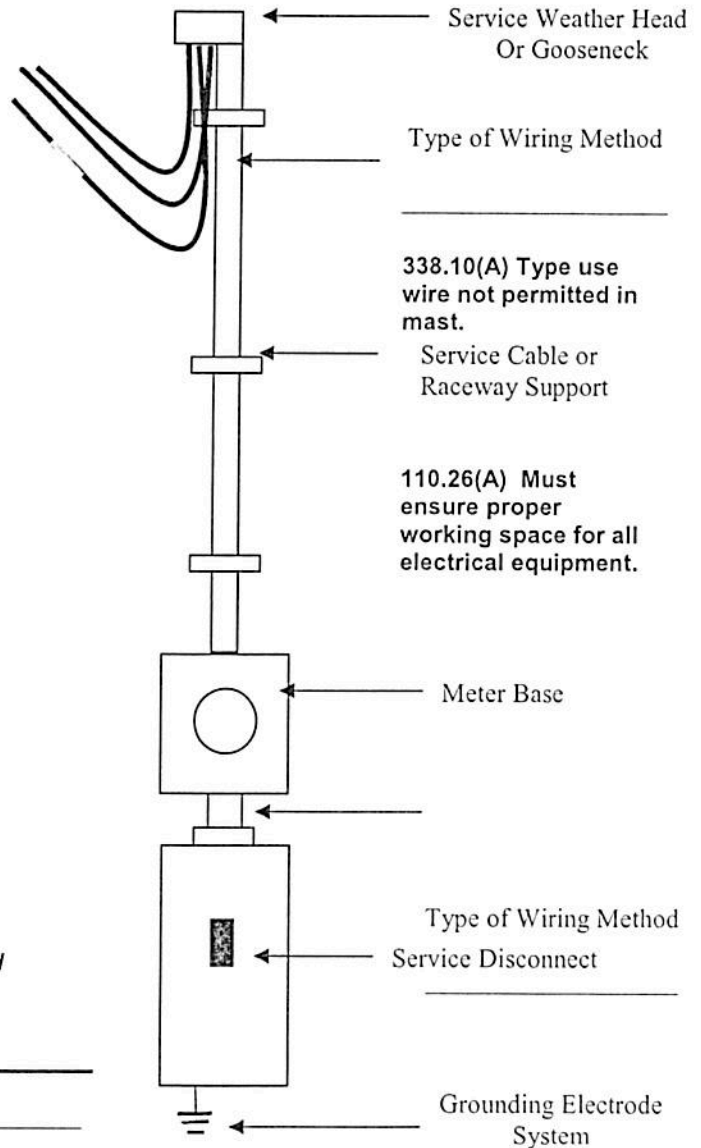

I hereby do certify that all information given above is correct and accurate and has been included as part of the submitted plans.

PRINTED NAME (Owner/Applicant) _____ TITLE _____

SIGNATURE _____ DATE _____

Ohio Residential Plan Submittal Form *(Underground Electrical Service)*

Address of Project	City	Project Description		
Contractor/DBA	Address	State License No	Phone No	Cell Phone No
Owner	Address	Phone No		Cell Phone No


Electrical Design

Panel Location in dwelling (Basement, Garage, etc.)	Size of Service in Amperes: (Check one below)				NEC 310-15 Conductor Sizes 120/240 VOLT 3-Wire, Single-Phase, Dwelling Services/Feeders
	Copper	Aluminum	Service Rating		
<input type="checkbox"/>	4 AWG	2 AWG	100 Amps		
<input type="checkbox"/>	1 AWG	2/0 AWG	150 Amps		
	<input type="checkbox"/>	2/0 AWG	4/0 AWG	200 Amps	

Electrical Service Requirements

This information is not intended as a design specification or as an instruction for untrained persons.
NEC 110.3 All electrical equipment shall be installed and used in accordance with the listing requirements and manufacturer's instructions.
NEC 250.50 All grounding electrodes that are present at each building or structure served shall be bonded together to form the grounding electrode system. Conductor size per NEC 250.66. NEC 250.52 Permitted Electrodes include: 1. Metal underground water pipe in direct contact with earth for 10 feet or more 2. Metal frame of the building 3. Concrete-encased electrode 4. Rod, pipe & plate electrodes
NEC 230.66 Service equipment shall be marked to identify it as being suitable for use as service equipment.
NEC 230.70(A)(1) The service disconnecting means shall be installed at a readily accessible location either outside of a building or structure or inside nearest the point of entrance of the service conductors
NEC 230.70(A)(3) Service disconnecting means shall not be installed in bathrooms.
NEC 230.71(A) & 230.72(A) The service disconnect shall consist of not more than six switches or six sets of circuit breakers. These switches or circuit breakers shall be grouped at one location.
NEC 230.79(C) The service disconnect shall have a rating of not less than 100 amperes.
NEC 230.90 & 230.91 Each ungrounded service conductor shall have overload protection. The service overcurrent device shall be an integral part of the service disconnecting means or shall be located immediately adjacent thereto.
NEC 110.26(A) Must ensure proper working space for <u>all electrical equipment</u> .
NEC 338.10(A) Type use wire used for service laterals shall be permitted to emerge from the ground outside at terminations in meter base.

NEC 300.5 Direct buried cable or conduit is required to comply with NEC Table 300.5. Service conductors that are not encased with concrete 18 inches or more below grade shall have their location identified by a warning ribbon placed 12 inches above the underground installation.

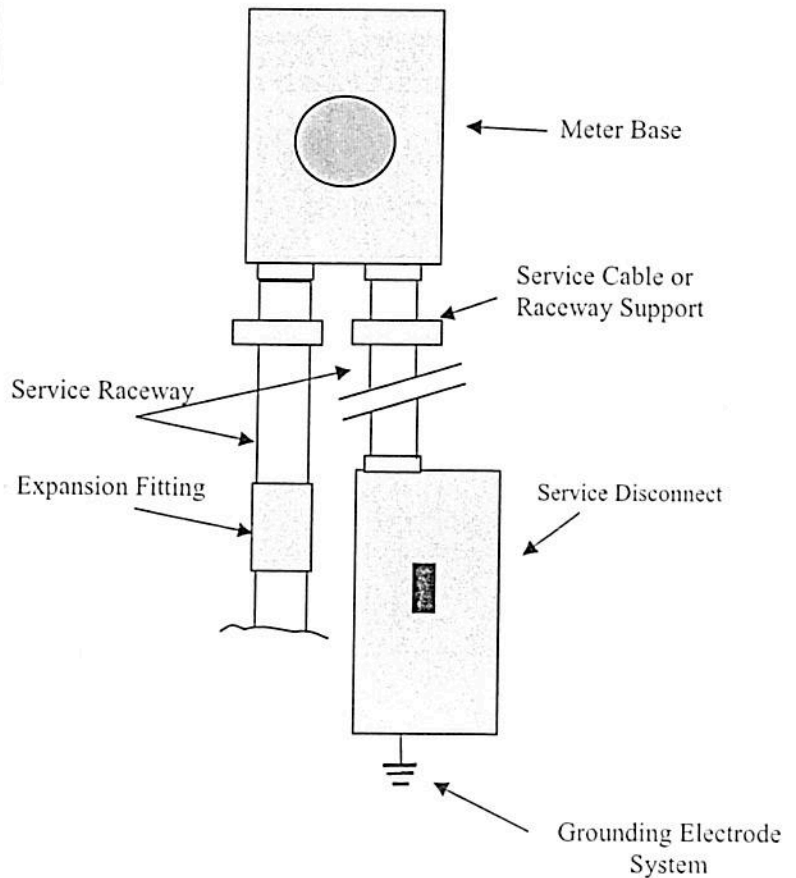

I hereby do certify that all information given above is correct and accurate and has been included as part of the submitted plans.

 PRINTED NAME (Owner/Applicant) TITLE

 SIGNATURE DATE